

Single-Family Stairways/Guards Information Sheet

Width

Stairways shall not be less than 36 inches wide. The handrail may enter a maximum of 4-1/2 inches into this dimension. If placing two handrails on a stairway, maintain a minimum of 27 inches.

Dimensional tolerances

The largest tread depth or riser height within any stairway shall not exceed the smallest by more than 3/8 inch.

Risers

Open risers are permitted, provided that the opening between treads does not exceed 4 inches. This does not apply if less than 30 inches above floor or grade.

Headroom

Every stairway shall have a headroom clearance of not less than 6 feet 8 inches. The minimum headroom in all parts of the stairway may not be less than 6 feet 8 inches. This is measured vertically from the sloped plane adjoining the tread *nosings* or from the floor surface of the landings.

Handrails

REQUIRED AT FOUR OR MORE RISERS.

The top shall be placed not less than 34 inches, nor more than 38 inches, above the nosing of the treads. Ends shall be re-turned or terminated in newel posts or safety terminals.

All required handrails shall be continuous for the full length of the stairs from a point directly above the top riser of the flight to a point directly above the lowest riser of the flight.

Guard opening limitations INTERMEDIATE RAIL SPACING OR PATTERN 4" sphere cannot pass through 4-3/8" at **OPEN** stair rail only **STAIRWAYS GUARD** 34" Minimum **HEIGHT** for quardrail/ 36" handrail minimum 4" TRIANGULAR AREA FORMED BY TREAD. **RISER AND GUARDRAIL** 6" sphere cannot pass through


Exceptions:


- 1. Handrails may be interrupted by a newel post at a turn.
- 2. A volute, turnout or newel post is allowed over the lowest tread.

The outside diameter of a circular handrail may be no less than 1-1/4 inches and no greater than 2 inches. A non-circular must have a perimeter dimension of at least 4 inches and no greater than 6-1/4 inches. The maximum cross section is 2-1/4 inches. See page 2.

Illumination

All interior and exterior stairways must be illuminated.

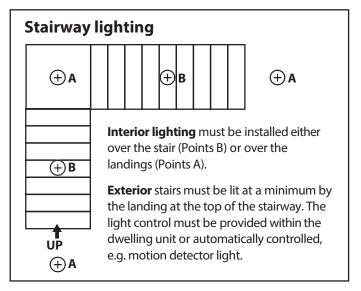

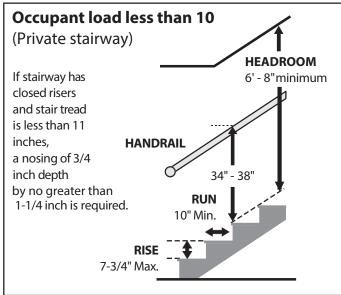

NOTE: REQUIRED HANDRAILS ARE NOT SHOWN

