



**BUILDING SIGNAGE SPECIFICATIONS**  
**(2020 MSFC)**

**Address**

Address number shall be provided. Refer to Shakopee Fire Department handout on Premises Identification.

**FDC Signage**

Reflective sign for FDC: Minimum 18" x 12" with engineer grade reflective sheeting. Red reflective letters on a white reflective background. This sign is available from the Shakopee Fire Department. Refer to Exterior Signage Detail sheet for mounting location.

**Door Labels**

Letters shall be of a contrasting color to the background.

**Exterior** - Labels on exterior doors shall identify the door use and property address.  
The main wording shall be in 3" letters with secondary wording in 1.5" letters.

**Fire Access**

Address #

**Stairs**

Basement thru 4th  
Roof Access

**Riser Room**

Address #  
No Building Access

**Interior** - Labels on interior doors shall identify the door use.  
Wording shall be in 1.5" letters. Reduced size letters shall be pre-approved by the Shakopee Fire Department.

**Fire Access**

**Riser Room**

**Roof Access**


**Electrical Room**

**Mechanical Room**

**Fire Alarm Panel**

## NFPA 704 Sign

An NFPA 704 diamond sign shall be provided on all buildings containing reportable quantities of hazardous materials. The minimum sign size shall be 11" x 11". Smaller signs may be approved depending on material quantities and occupancy type.

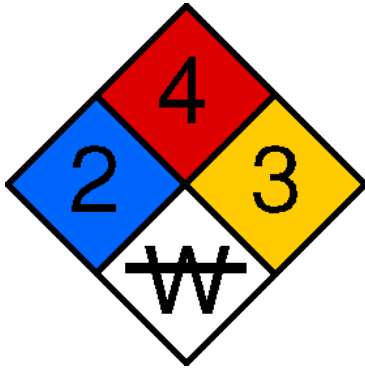

Proper information shall be placed in each colored box to represent the most hazardous level chemical located within the building.

Blue (Health)	0 – 4
Red (Flammability)	0 – 4
Yellow (Instability)	0 – 4
White (Special Precautions)	

Date: 04/01/2020  
Page 2/2  
Building Signage Specifications.doc